




Tloris



Prerez B-B

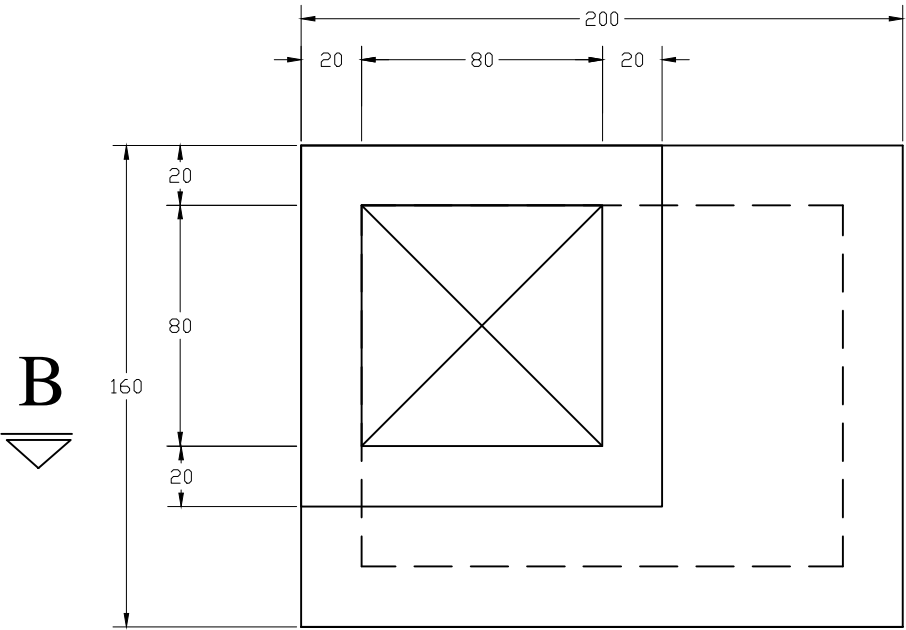

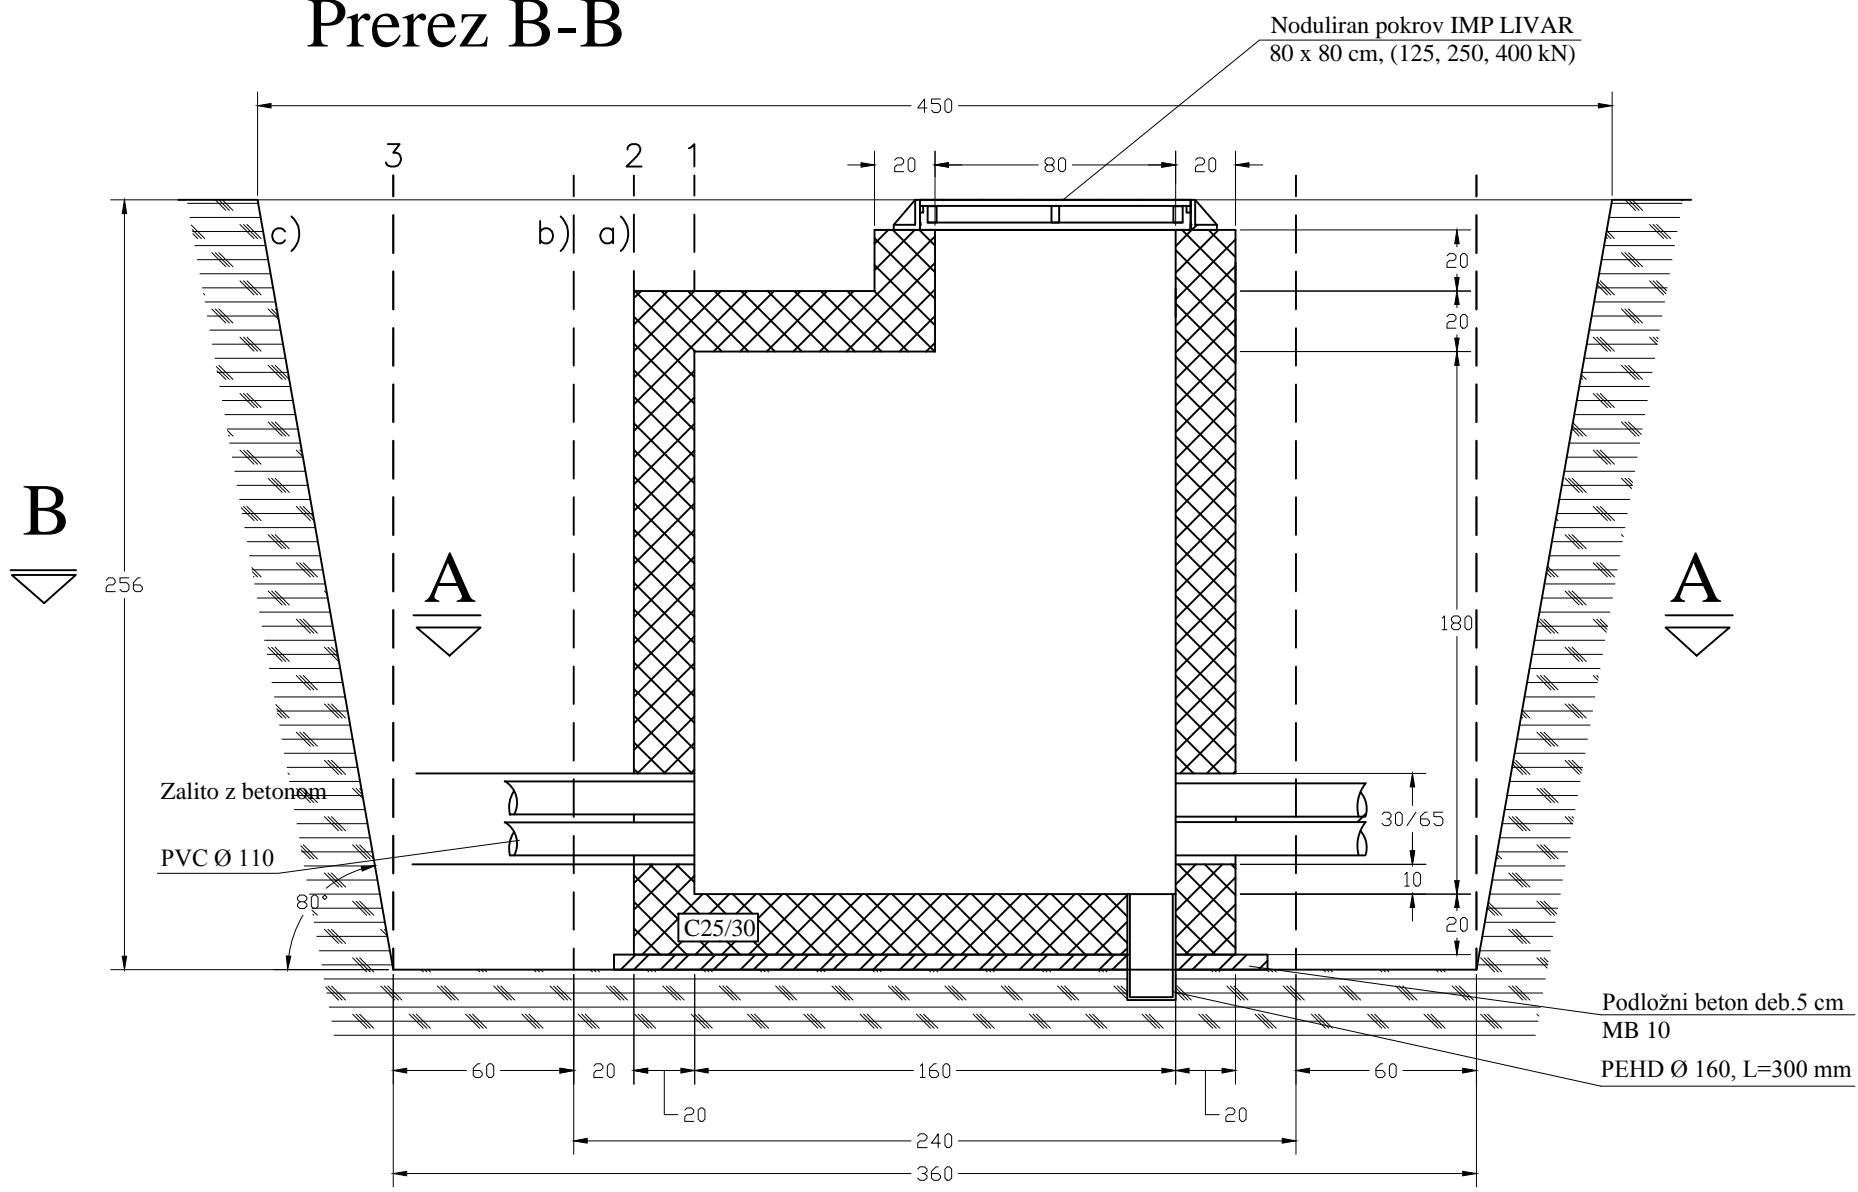

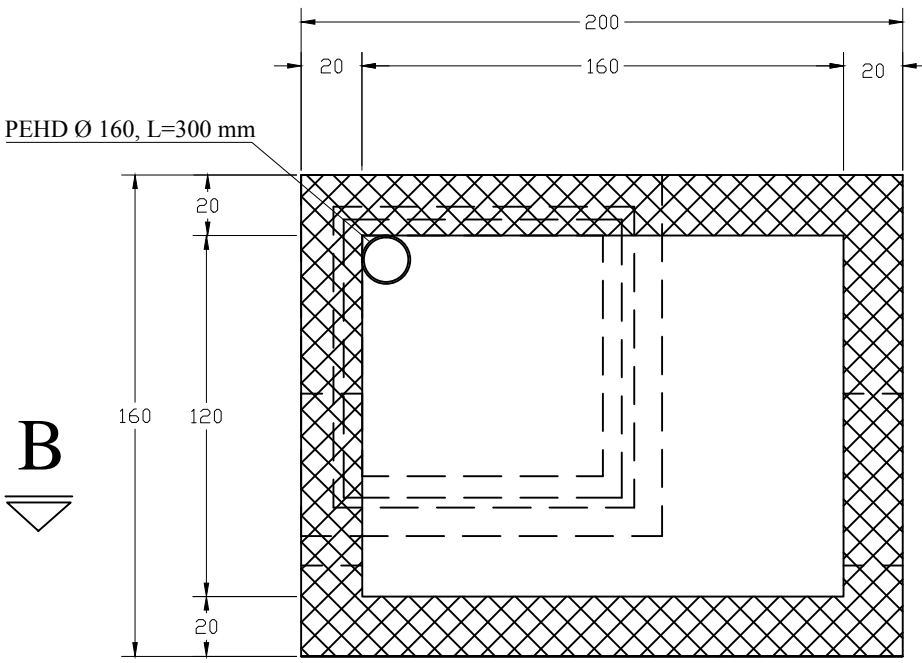Prerez A-A



| | | |
|-----------------------------|-----------------------------|---|
| Enostranski opaž (1): | Dvostranski opaž (1-2): | Dvostranski opaž (1-2) z varnostnim opažem (3): |
| $Q_{IZKOP\ a)} = 8,2\ m^3$ | $Q_{IZKOP\ b)} = 12,3\ m^3$ | $Q_{IZKOP\ c)} = 37,8\ m^3$ |
| $Q_{BET.\ MB30} = 4\ m^3$ | $Q_{BET.\ MB30} = 4\ m^3$ | $Q_{BET.\ MB30} = 4\ m^3$ |
| $Q_{BET.\ MB10} = 0,3\ m^3$ | $Q_{BET.\ MB10} = 0,3\ m^3$ | $Q_{BET.\ MB10} = 0,3\ m^3$ |

Gradbene jame in izkopi, ki so globlji od 2 m in imajo brežine urejene pod kotom 45° (bolj strmo), morajo imeti najmanj 100 cm od zgornjega roba postavljeno varnostno ograjo.

| | | | | | | | |
|---|--|-----------------|--|---|--|-------------------|--|
| Sprememba | | Opis spremembe | | Datum: | | Podpis: | |
|  Elektro Celje, d.d. Vrunčeva 2a, 3000 Celje | | | | Objekt/lokacija: | | | |
| Investitor: ELEKTRO CELJE, d.d., Vrunčeva 2a, 3000 Celje | | | | Vsebina/naslov risbe: Kabelski jašek 1,2 x 1,6 x 1,8 m gradbeni načrt | | | |
| Odg. projektant: | | Ime in priimek: | | Id. št.: | | Podpis: | |
| Izdelal: | | | | | | | |
| Kontroliral: | | | | | | | |
|  | | Merilo: 1:25 | | Datum: | | Vrsta projekta: | |
| | | | | | | Risba št.: | |
| | | | | | | St./od st. 1/1 | |