




Tloris

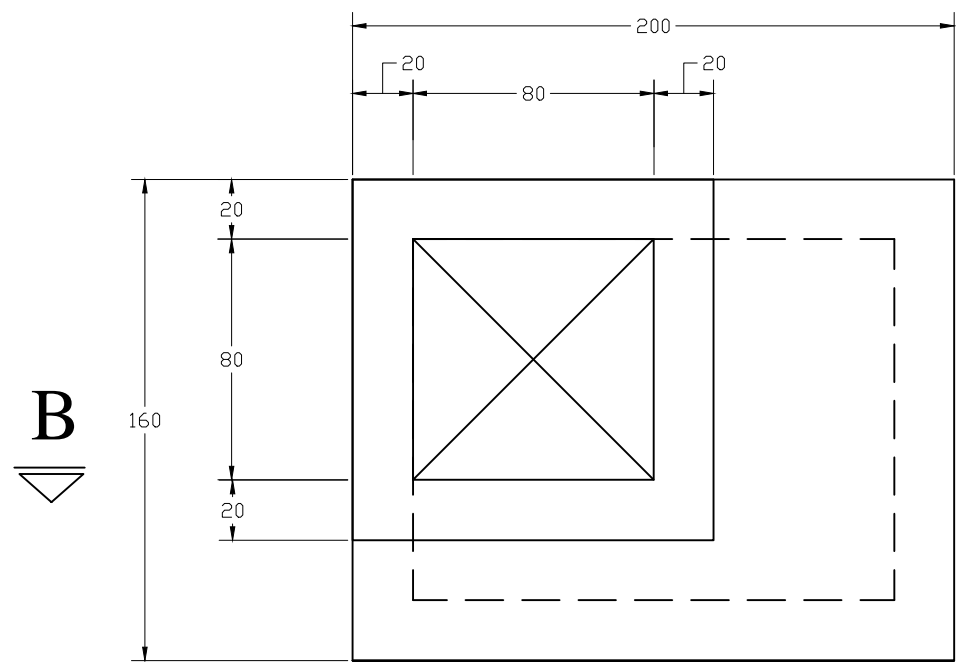

Prerez B-B

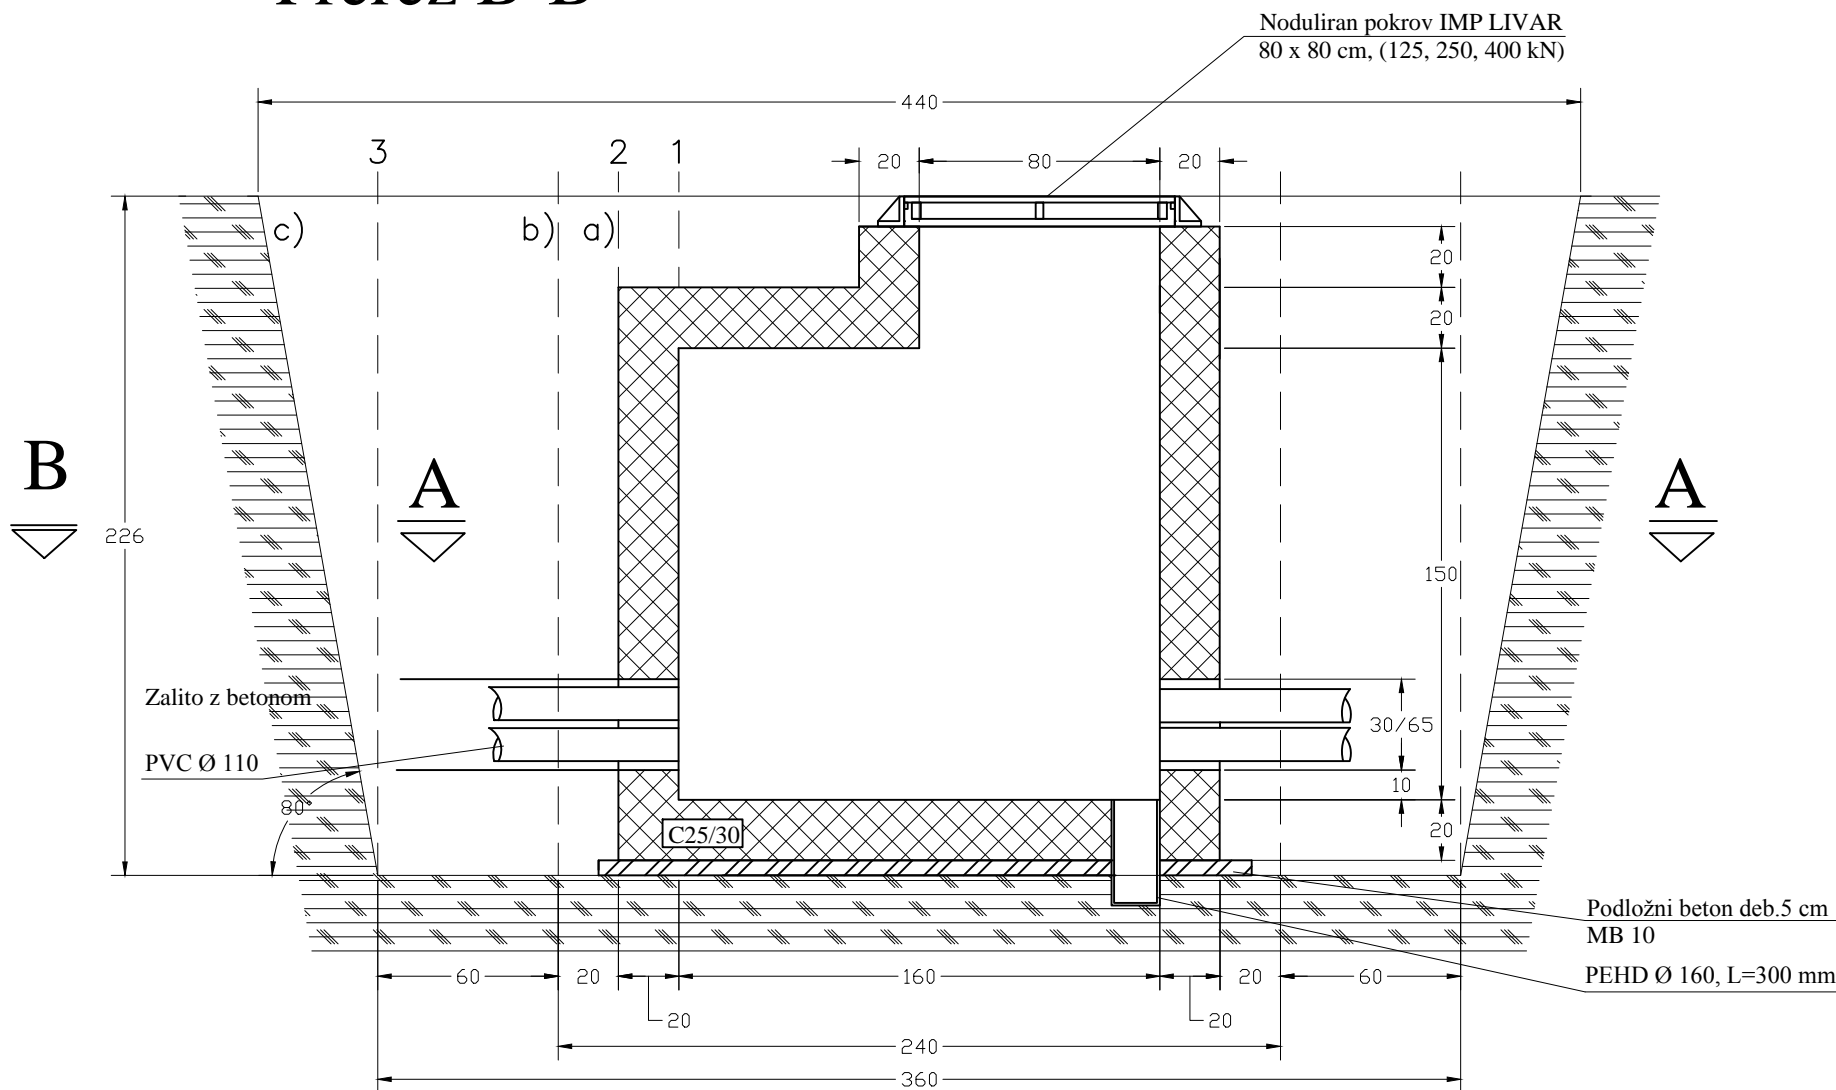

Prerez A-A

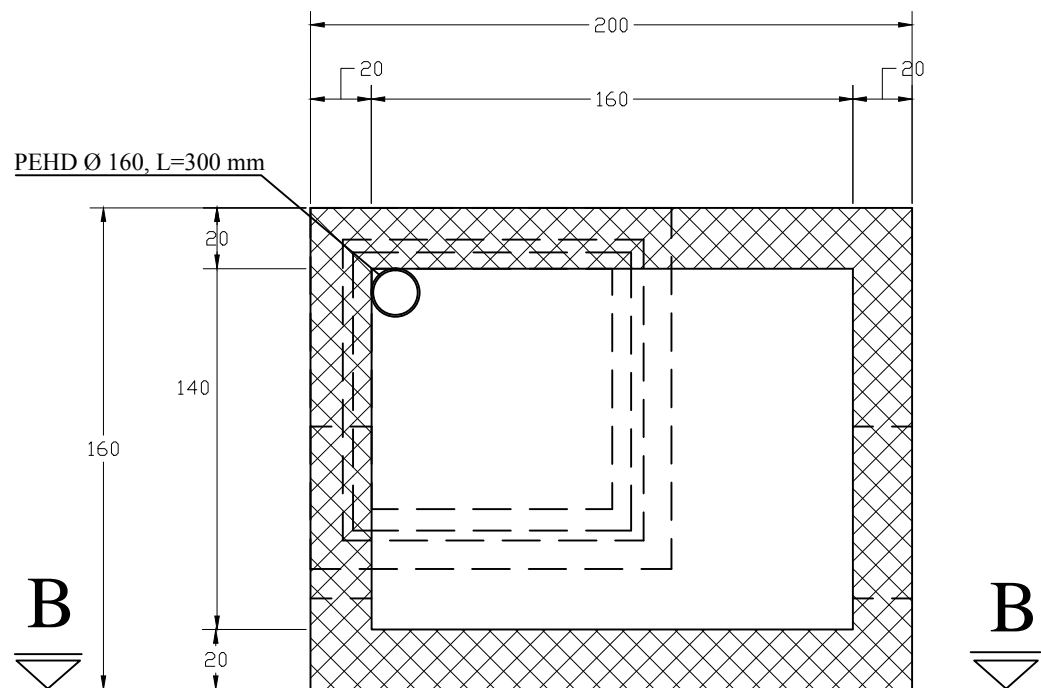

Gradbene jame in izkopi, ki so globlji od 2 m in imajo brežine urejene pod kotom 45° (bolj strmo), morajo imeti najmanj 100 cm od zgornjega roba postavljeno varnostno ograjo.

Enostranski opaž (1):



$Q_{IZKOP\ a)} = 8,0\ m^3$
$Q_{BET.\ MB30} = 3,6\ m^3$
$Q_{BET.\ MB10} = 0,3\ m^3$

Dvostranski opaž (1-2):

$Q_{IZKOP\ b)} = 11,5\ m^3$
$Q_{BET.\ MB30} = 3,6\ m^3$
$Q_{BET.\ MB10} = 0,3\ m^3$

Dvostranski opaž (1-2)  
z varnostnim opažem (3):

$Q_{IZKOP\ c)} = 29,5\ m^3$
$Q_{BET.\ MB30} = 3,6\ m^3$
$Q_{BET.\ MB10} = 0,3\ m^3$

Sprememba	Opis spremembe	Datum:	Podpis:
 <b>Elektro Celje, d.d.</b> Vrtnčeva 2a, 3000 Celje		Objekt/lokacija:	
Investitor/Naročnik: ELEKTRO CELJE, d.d., Vrtnčeva 2a, 3000 Celje		Vsebina/naslov risbe: Kabelski jašek notranjih dimenzij 1,2 x 1,6 x 1,5 m - gradbeni načrt	
Odgo. projektant:	Ime in priimek:	Id. št.:	Podpis:
Izdelal:			
Kontroliral:			
 Merilo: 1:25		Datum:	
		Vrsta projekta:	Risba št.:
			St./od st. 1/1